



- Generator stator earth fault protection
- Winding insulation protection
- For use with 1A or 5A current transformers
- The Pathfinder eases fault finding
- Up to two individual very fast analogue output signals (<50mS), (optional)
- DIN96 Slave Indicator (scaled 0-40%In) with status LEDs (Optional)

Specifications

Standard Auxiliary Voltage:	24-60VDC (Fuse 0,5A) 110-220VDC (Fuse 1A)
Optional Auxiliary Voltage:	100-120V, 200-240V, 380-415V, 440-460V, 480VAC, 40-70Hz (Fuse 0,5A)
Supply tolerance:	+10%, -20%
Power rating:	5VA
Current Input:	1A CT or 5A CT, <0,1VA
Contact rating:	AC: 100VA -250V/2A max. DC: 50W -100V/1A max.
Adjustments:	See table on the right
Ampere range:	Any % of the CT value
Analogue output 1: (see page 2 for available outputs)	mA: Up to 20mA, max 500R V: Up to 10V, min 100kohm (other on request)
Analogue output 2: (see page 2 for available outputs)	mA: Up to 20mA, max 500R V: Up to 10V, min 500ohm (other on request)
Accuracy:	Class 0,5
Temperature:	-20 to +70°C
Humidity, relative:	0-95%
Weight:	0.6kgs
Front protection:	IP21
Flammability:	UL94-V0

Description

The digitally controlled KCC112x protects against phase-, earth- and winding faults within the protected area (the stator) of large AC generators. It detects even minute insulation punctures, flash-over carbon deposits and contamination. The unit measures highest up differential current from antiparalleled CTs in a Merz-Price configuration, by comparing current levels at the end of each phase winding.

Alarm trip must be set sufficiently high to ensure that generator magnetisation current does not cause tripping. The alarm delay is to be set so that the initial inrush current have returned to normal level before the delay period elapses. The warning trip level and delay can be set as required to give early warning.

User settable trip levels and delays. Colour of LEDs indicate alarm status. Alarm LEDs flash during count-down.

Up to two individual very fast analogue output signals (optional) proportional to highest up current (see page 2 for available outputs). The analogue output is isolated from the CT and auxiliary power.


Relay Configurations

R1 is used for early warning. R2 or R3 (fail safe) is to be used for generator breaker trip, the other alarm relay can be used for local indication input to PMS, alarm system etc.

Relay	Warning	Alarm	Fail Safe	Latch
R1	X			
R2		X		*X
R3		X	X	*X

LED status		
Power	Warning	Alarm
●	●	●
Normal	Alarm	Alarm

Relays shown de-energised.
R3 are fail-safe and energises when unit is powered.
*X) See the table below for models with latch function




Models	Latch	O/P 1	O/P 2	Hysteresis	Pathfinder
KCC112E	X	-	-	-	X
KCC112FA	X	X	-	-	X
KCC112FB	X	X	X	-	X
KCC112G	-	-	-	-	-
KCC112GFA	-	X	-	-	-
KCC112GFB	-	X	X	-	-

The unit meets EN 60255-27 Cat. III, Pollution degree 2 and the relevant environmental and EMC tests specified in EN 60255-26 to comply with the requirements of the major Classification Societies.



Related information:
The KCC112x series are also available for panel mounting as KPC112x series.

Adjustments	Trip level	Delay
Warning:	0-100% of set alarm trip level	0-30secs
Alarm:	0-40% of I nom.	0-3secs

The Pathfinder (only on latching models) indicates the phase causing the trip by flashing pattern of the relevant LED.



Connection Diagram

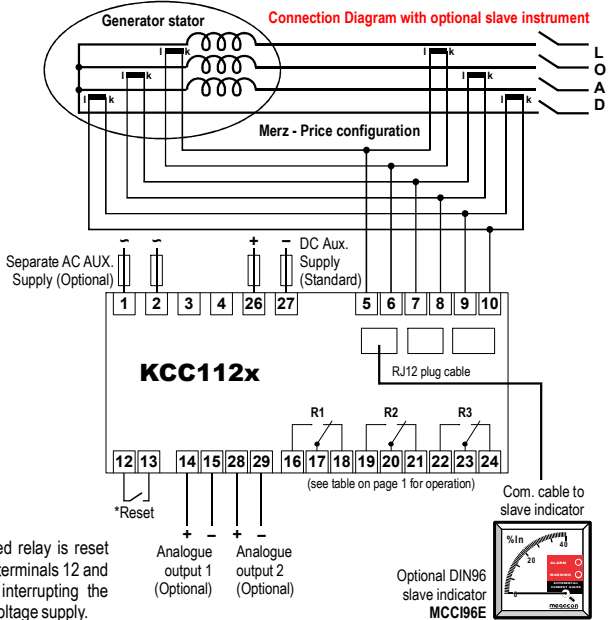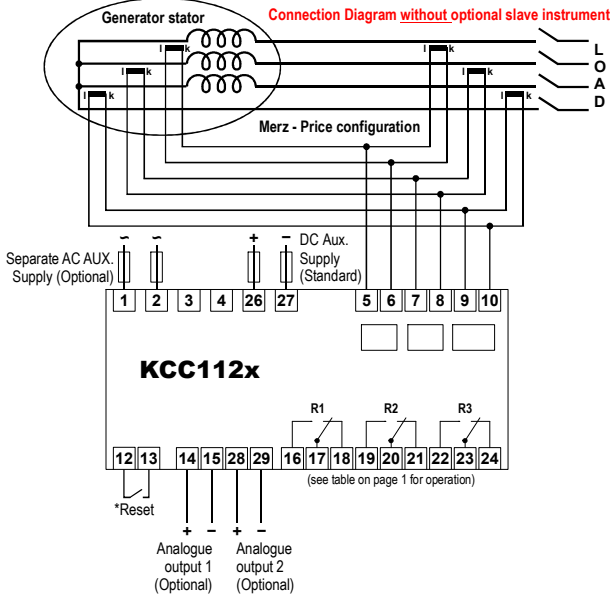

***Reset**
Any latched relay is reset by linking terminals 12 and 13 or by interrupting the auxiliary voltage supply.

Analogue Output

The output signals are proportional to the meter reading (see page 1 for an overview of models and functions).

The signal is specifically intended as an input to a control system for monitoring or control.

Add suffix from table below to type designation to specify output required:

Outputs 1

O/P1	0 - 10mA
O/P2	0 - 20mA
O/P3	4 - 20mA
O/P4	N/A
O/P5	N/A
O/P6	N/A
O/P7	N/A
O/P8	0 - 10V
O/P9	0,2 - 10V
O/P10	4,3 - 20mA

Outputs 2

O/P11	0 - 10mA
O/P12	0 - 20mA
O/P13	4 - 20mA
O/P14	N/A
O/P15	N/A
O/P16	N/A
O/P17	N/A
O/P18	0 - 10V
O/P19	0,2 - 10V
O/P20	4,3 - 20mA

Relay Contacts

Burden on supply	: 170mW per relay
Switching voltage (Max)	: 400V AC, 300V DC
Switching voltage (Rated)	: 250V AC, 30V DC
Max I continuous	: 6A RMS, 6A DC
Max breaking capacity	: 1500VA AC, 18-120W DC
Dielectric strength across Open contacts	: 1000V RMS


Connection

Terminal type	: Terminal Clamp and Screw
Wire max.	: T1-T4, T26-T27: AWG 24-14, T5-T10: AWG 12, other terminals: AWG 24-12
Screw Torque	: 0.5Nm

Overload

Voltage	: 1.2 x Un continuous 2 x Un for 10secs
Current	: 2.5 x In continuous 5 x In for 1secs (max 25A)

Dimensions

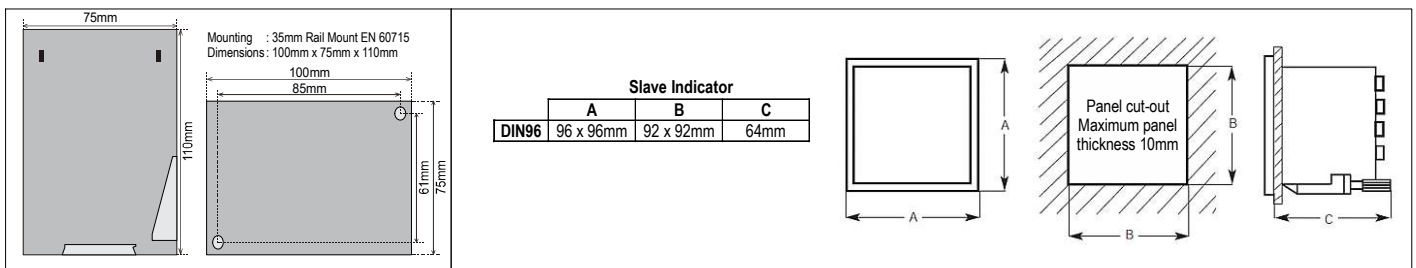

The MEGAcon policy is one of continuous improvement, consequently equipment supplied may vary in detail from this publication.

ORDERING INFORMATION

Type	: KCC112FB
Aux. Supply	: 24VDC
Input Current C.T.	: 4000/5A
I nominal (100%)	: 2995A
Analogue output 1	: O/P3: 4-20mA
Analogue output 2	: O/P18: 0-10VDC

Optional Separate Aux. Supply:
Add -SA for models with Separate AC Aux. Supply.
(Example: KCC112FB-SA)

