



- Combined AC Current (A), Active Power (Watt) or Reactive Power (VAR) Transducer for balanced or unbalanced load
- Precision true RMS class 0,5 (Watt) and class 1 (VAR) measurement, not affected by any waveform distortion
- For use with 1A or 5A current transformers
- Up to two individual very fast analogue output signals (<50mS), (optional)
- DIN96 Slave Indicators with full scale (optional)

Specifications

Monitored Voltage:	100-120V, 200-240V, 380-415V, 440-460V, 480VAC 40-70Hz (Fuse 0,5A)
Optional Separate Auxiliary Voltage AC:	100-120V, 200-240V, 380-415V, 440-460V, 480VAC 40-70Hz (Fuse 0,5A)
Optional Separate Auxiliary Voltage DC:	24-60VDC (Fuse 0,5A) 110-220VDC (Fuse 1A)
Supply tolerance:	+10%, -20%
Power rating:	5VA
Current Input:	1A CT or 5A CT, <0,1VA
Analogue output 1: (Any % of CT range) (see page 3 for available outputs)	mA: Up to 20mA, max 500R V: Up to 10V, min 100kohm (other on request)
Analogue output 2: (Watt or VAR range) (see page 3 for available outputs)	mA: Up to 20mA, max 500R V: Up to 10V, min 500ohm (other on request)
Accuracy:	Class 0,5 (Watt) Class 1 (VAR)
Temperature:	-20 to +70°C
Humidity, relative:	0-95%
Weight:	0.6kgs
Front protection:	IP21
Flammability:	UL94-V0

The unit meets EN 60255-27 Cat. III, Pollution degree 2 and the relevant environmental and EMC tests specified in EN 60255-26 to comply with the requirements of the major Classification Societies.

Description

The digitally controlled MT-AW/R is a precision transducer for AC Current and balanced or unbalanced load system active (Watt) or reactive (VAR).

To be used in applications that require a very fast response, precision monitoring of active or reactive power. Ideal for systems for regulation and control of the load on generators, motors and inverters.

The unit measures the voltage and current true r.m.s. value, and accuracy is independent of any waveform distortion. A green LED (ON) indicates the auxiliary supply presence.



Two individual very fast analogue output signals proportional to AC Current (A) and the measured ActivePower (Watt) or Reactive Power (VAR) level. (see page 3 for an overview of models).

If an output is used for remote meter reading, we recommend 0-1mA for the slave indicator.

It also includes an additional RJ12 output for a DIN96 Slave Indicator (optional).


The noise-immune mA output is isolated from both the C.T. and voltage inputs and auxiliary power.

The standard models takes the auxiliary supply voltage from the monitored voltage (terminal 1 & 2).

It can also be delivered with optional separate AC or DC auxiliary voltage (terminal 26 & 27), but that must be specified when ordering (see page 3 for ordering code for separate Aux. Supply).


Connection Diagram

MT-A1W2
MT-A1R2

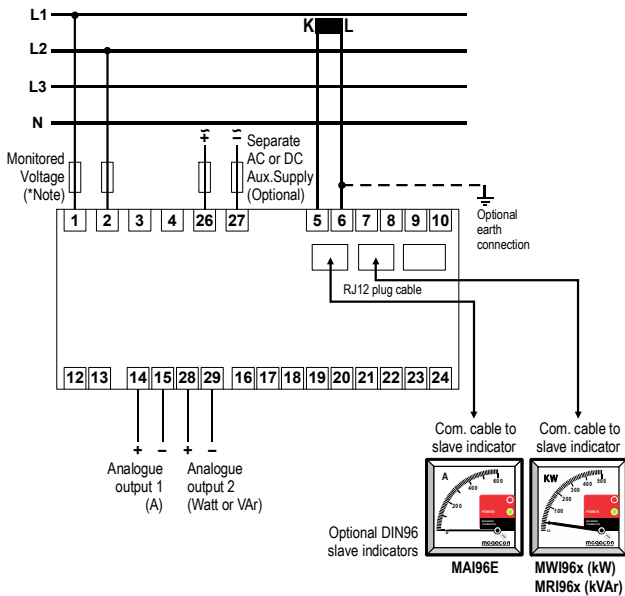


Connection Diagram

MT-A1W3
MT-A1R3

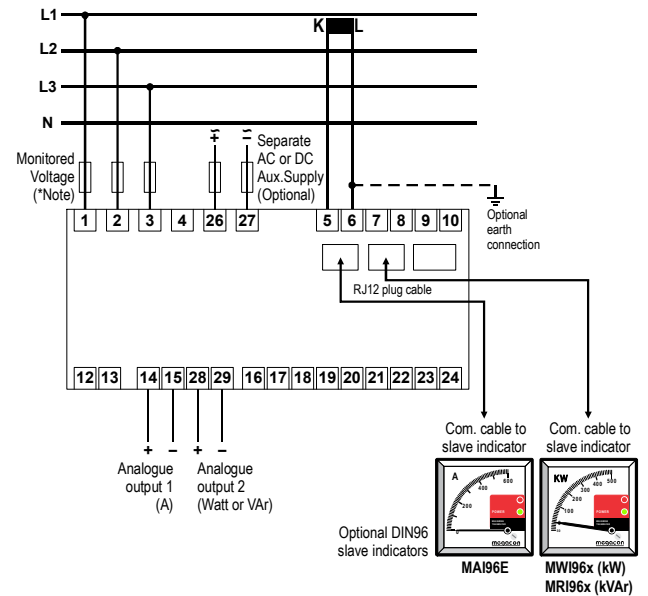


Connection Diagram

MT-A2W3 MT-A3W3
MT-A2R3 MT-A3R3
Dotted wire is for
MT-A3W3 & MT-A3R3

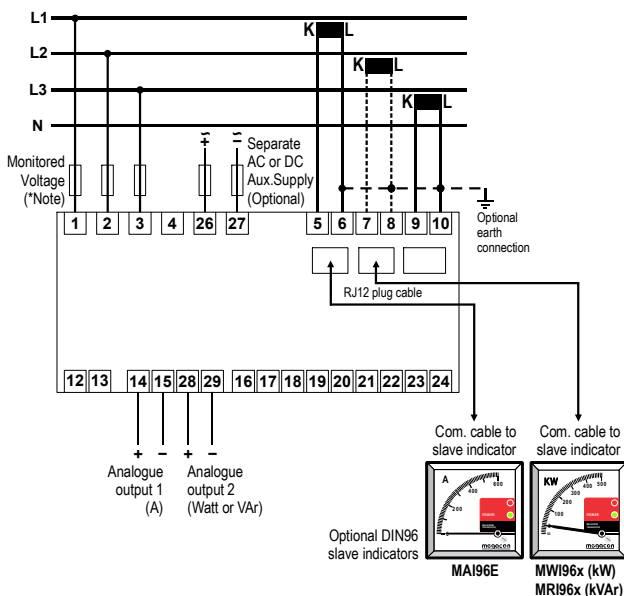

Connection Diagram

MT-A1W4 MT-A3W4
MT-A1R4 MT-A3R4
Dotted wire is for
MT-A3W4 & MT-A3R4

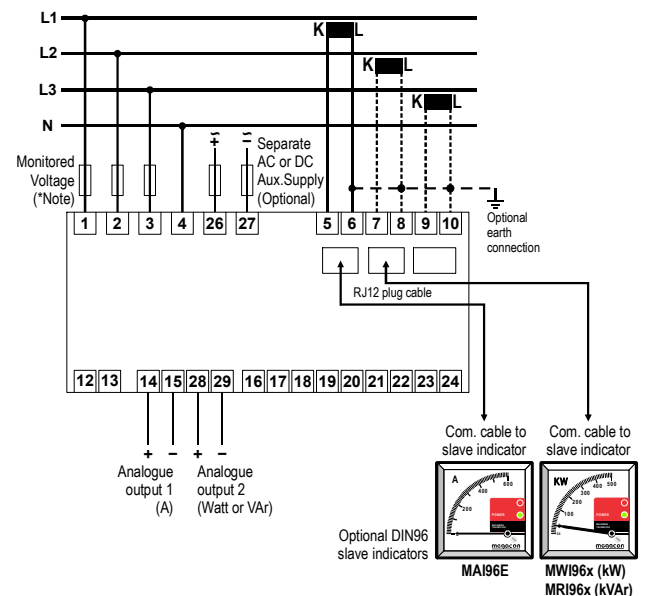

The MEGACon policy is one of continuous improvement, consequently equipment supplied may vary in detail from this publication.

***Note:** The standard models takes the auxiliary supply voltage from the monitored voltage (terminal 1 & 2).

Info: To ensure correct kW or kVAr measurement, the voltage phase sequence and CT connections must be as shown on connection diagrams. (See page 3 for an overview of models)




Model Overview

Models	AC Current (A) and Active Power (W)	O/P 1	O/P 2
MT-A1W2	1 element, single phase	X	X
MT-A1W3	1 element, 3 phase, 3 wire, balanced load	X	X
MT-A1W4	1 element, 3 phase, 4 wire, balanced load	X	X
MT-A2W3	2 element, 3 phase, 3 wire, unbalanced load	X	X
MT-A3W3	3 element, 3 phase, 3 wire, unbalanced load	X	X
MT-A3W4	3 element, 3 phase, 4 wire, unbalanced load	X	X

Models	AC Current (A) and Reactive Power (R)	O/P 1	O/P 2
MT-A1R2	1 element, single phase	X	X
MT-A1R3	1 element, 3 phase, 3 wire, balanced load	X	X
MT-A1R4	1 element, 3 phase, 4 wire, balanced load	X	X
MT-A2R3	2 element, 3 phase, 3 wire, unbalanced load	X	X
MT-A3R3	3 element, 3 phase, 3 wire, unbalanced load	X	X
MT-A3R4	3 element, 3 phase, 4 wire, unbalanced load	X	X

Scaling for optional DIN96 slave indicator

Shown below are designations for the available circuit configurations:

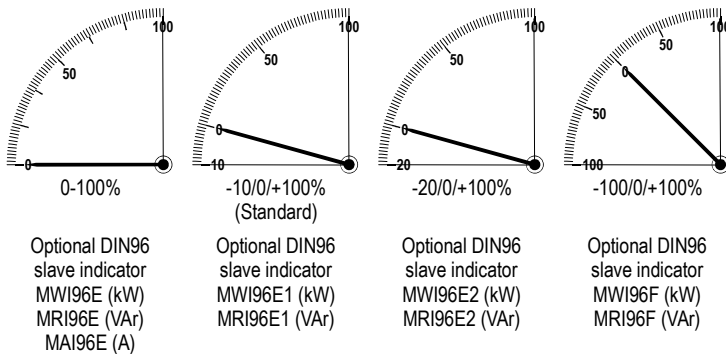

Analogue Output

The output signals are proportional to the meter reading.

The signal is specifically intended as an input to a control system for monitoring or control.

Add suffix from table below to type designation to specify output required:

Outputs 1 (A)	Outputs 2 (Watt or VAr)
O/P1 0-10mA	O/P11 0-10mA
O/P2 0-20mA	O/P12 0-20mA
O/P3 4-20mA	O/P13 4-20mA
O/P4 N/A	O/P14 4-12-20mA
O/P5 N/A	O/P15 4-5,45-20mA
O/P6 N/A	O/P16 -10-0-+10mA
O/P7 N/A	O/P17 -20-0-+20mA
O/P8 0-10V	O/P18 0-10V
O/P9 0,2-10V	O/P19 0,2-10V
O/P10 4,3-20mA	O/P20 4,3-20mA

Connection

Terminal type : Terminal Clamp and Screw
Wire max. : T1-T4,
T26-T27: AWG 24-14,
T5-T10: AWG 12,
other terminals: AWG 24-12


Screw Torque : 0.5Nm

Overload

Voltage : 1.2 x Un continuous
2 x Un for 10secs

Current : 2.5 x In continuous
5 x In for 1secs (max 25A)

Dimensions

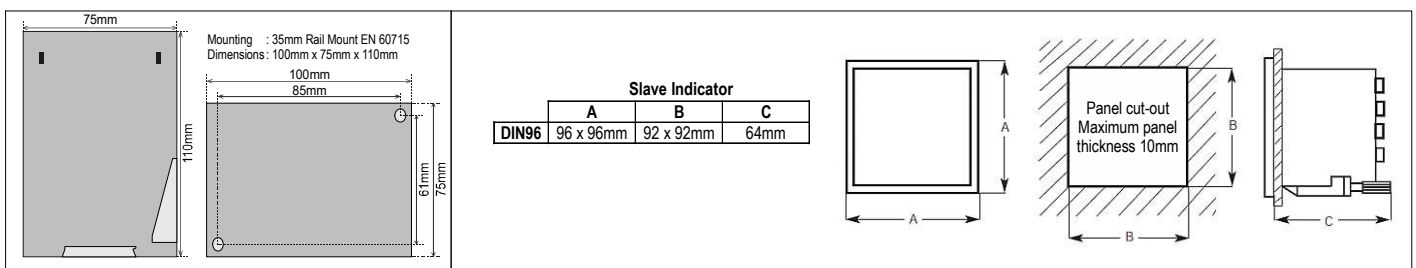

The MEGACon policy is one of continuous improvement, consequently equipment supplied may vary in detail from this publication.

ORDERING INFORMATION (Example)

Type : MT-A2W3
Aux. Supply : 200-240VAC
Input Voltage : 230V
Input Current C.T. : 1500/5A
A range : 0-1500A
kW range : -60/0/+600kW
Analogue output 1 : O/P3: 4-20mA
Analogue output 2 : O/P18: 0-10VDC

Optional Separate Aux. Supply:
Add -SA for models with Separate AC Aux. Supply.
(Example: MT-A2W3-SA)
Add -SD for models with Separate DC Aux. Supply.
(Example: MT-A2W3-SD)

